

# Fenwal Engineered Fire Suppression System

Designed for use with 3M™ Novec™ 1230 Fire Protection Fluid

Cylinder and Valve Assembly 600 lb. (372.1 kg) Capacity Data Sheet

F-44-2060



A UTC Fire & Security Company

P/N: 44-10060X-001

## FEATURES


- For use with UL Listed, ULC Listed, and FM Approvals Systems

## MATERIALS

- Valve Body: Brass
- Cylinder: Steel, Painted Red

## ORDERING INFORMATION

Part Number	Description
44-100600-001	STD
44-100601-001	with LLI

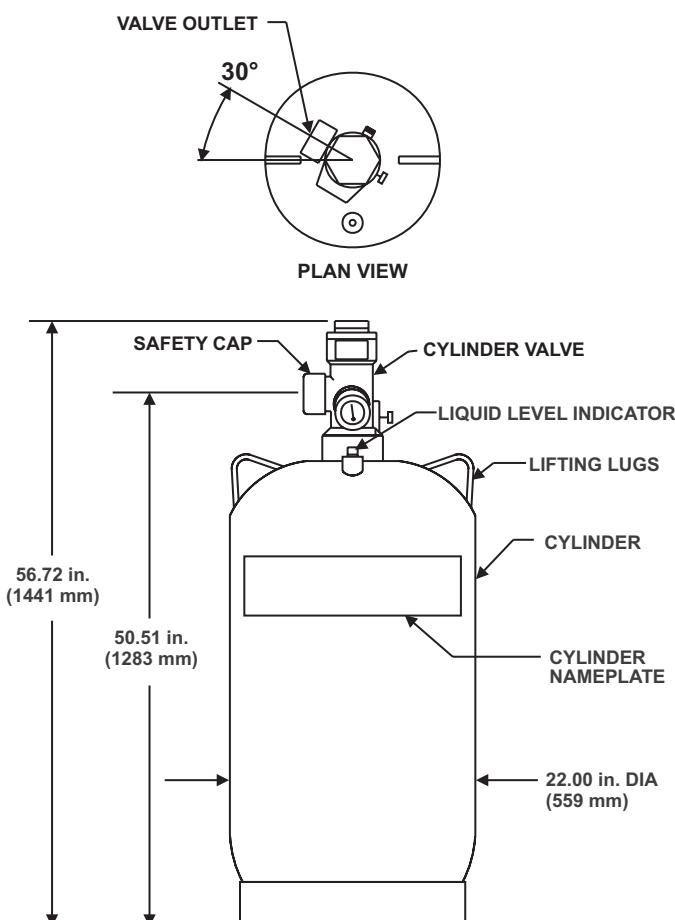

## NOTES

- The safety cap must be installed on the valve outlet at all times, except when the cylinders are connected to the system piping, or being filled. The safety cap must not be removed from its chain.
- See F-44-2070 for additional information.

Fenwal is a registered trademark of Kidde-Fenwal, Inc.  
3M and Novec are trademarks of 3M.  
All other trademarks are property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.

If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Fenwal Protection Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.fenwalfire.com](http://www.fenwalfire.com)