


CO₂ Component Description

Pressure Operated Switch

Effective: November 2016

K-81-5180 Rev AD

P/N: 81-486536-000

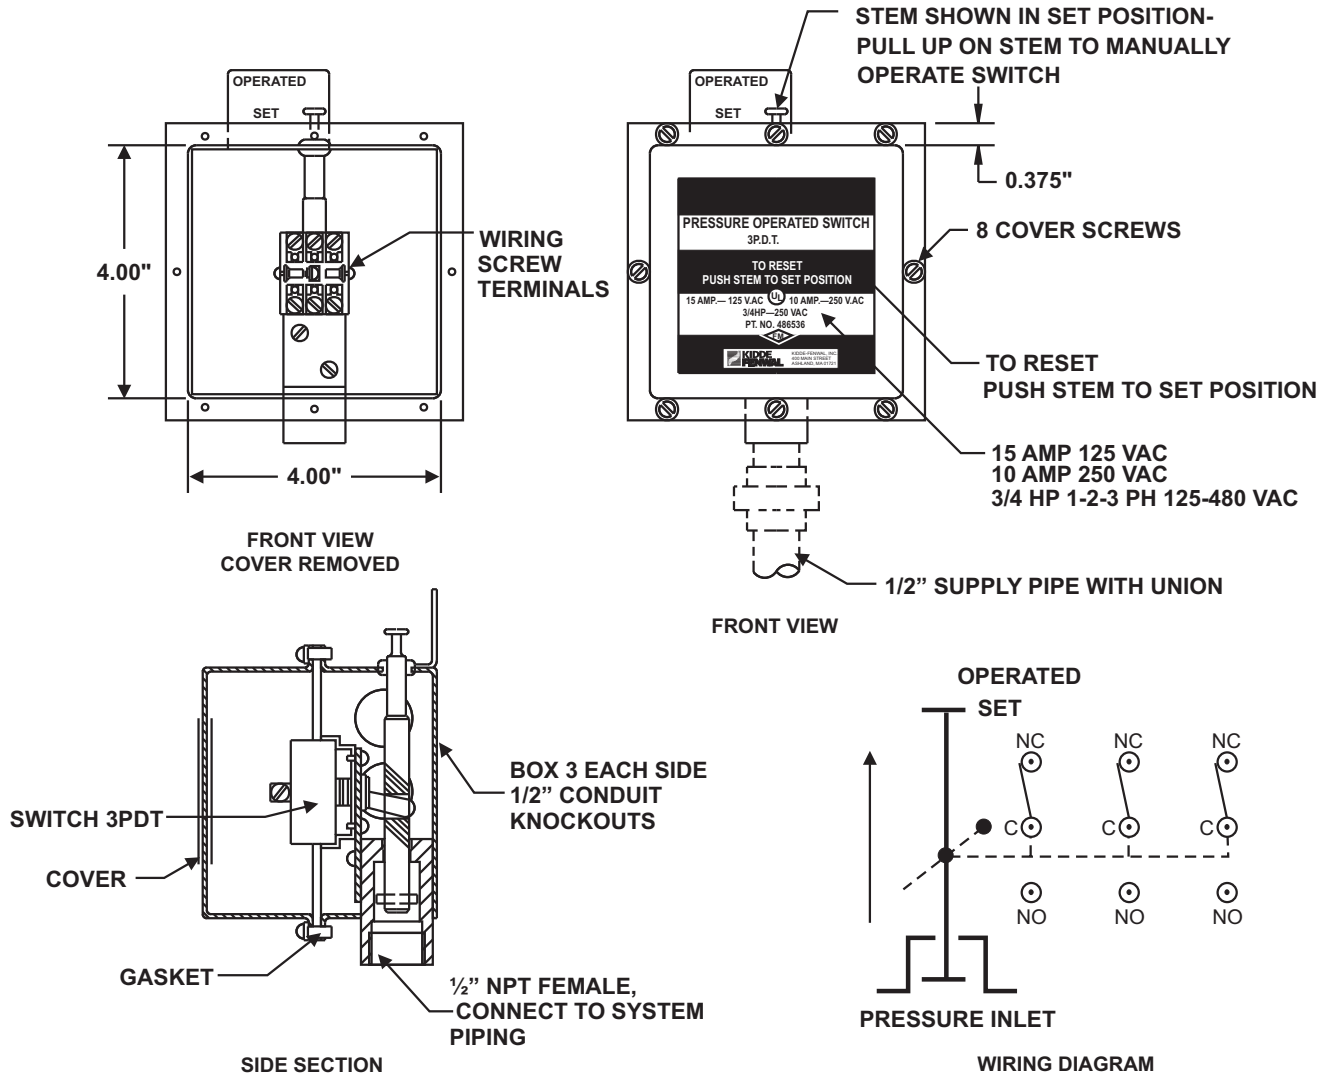

NOTES:

- The switch may be mounted in any position; however, the preferred installation is upright, as shown.
- Any load connection to the switch must not exceed the switch rating, and shall utilize a suitable protection device (i.e., circuit breaker, fuse).
- Contact Ratings (3 PDT):
 - 15 Amp @ 125 Vac
 - 10 amp @ 250 Vac
 - 3/4 HP @ 250 Vac
 - 1, 2 or 3 Phase

All trademarks are the property of their respective owners.

This literature is provided for informational purposes only. Kidde-Fenwal, Inc. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. The technical data contained herein is limited strictly for informational purposes only. Kidde-Fenwal, Inc. believes this data to be accurate, but it is published and presented without any guarantee or warranty whatsoever. If you need more information on this product, or if you have a particular problem or question, contact Kidde-Fenwal, Inc.

EXPORT INFORMATION (USA)
 Jurisdiction: EAR
 Classification: EAR99
 This document contains technical data subject to the EAR.

Kidde Fire Systems
 400 Main Street
 Ashland, MA 01721 USA
 Ph: 508.881.2000
 Fax: 508.881.8920
www.kiddefiresystems.com