


# CO<sub>2</sub> Component Description

## Hose Assembly

Effective: February 2007  
**K-81-1200**

PART NUMBER	HOSE SIZE	LENGTH	
		FT	M
907757	1/2 in.	25	7.6
961966	1/2 in.	50	15.2
918990	3/4 in.	25	7.6
918435	3/4 in.	50	15.2

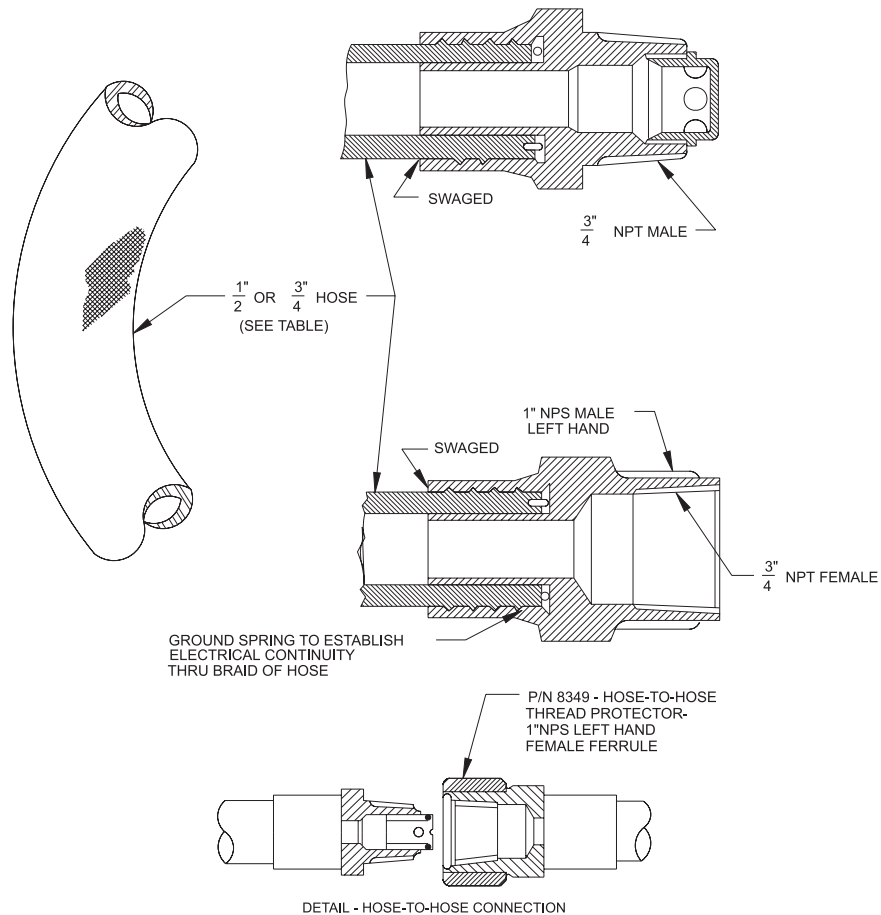

### MATERIALS

**HOSE: SYNTHETIC RUBBER WITH BRAIDED STEEL REINFORCEMENT TESTED TO 6000 PSI (414 BARS)**  
**COUPLING BRASS**

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.kiddefiresystems.com](http://www.kiddefiresystems.com)