

CO₂ Component Description




A UTC Fire & Security Company

Stop (Directional) Valves, 2-1/2-inch thru 3-inch

Effective: January 2009
K-81-5140

P/N: 890010

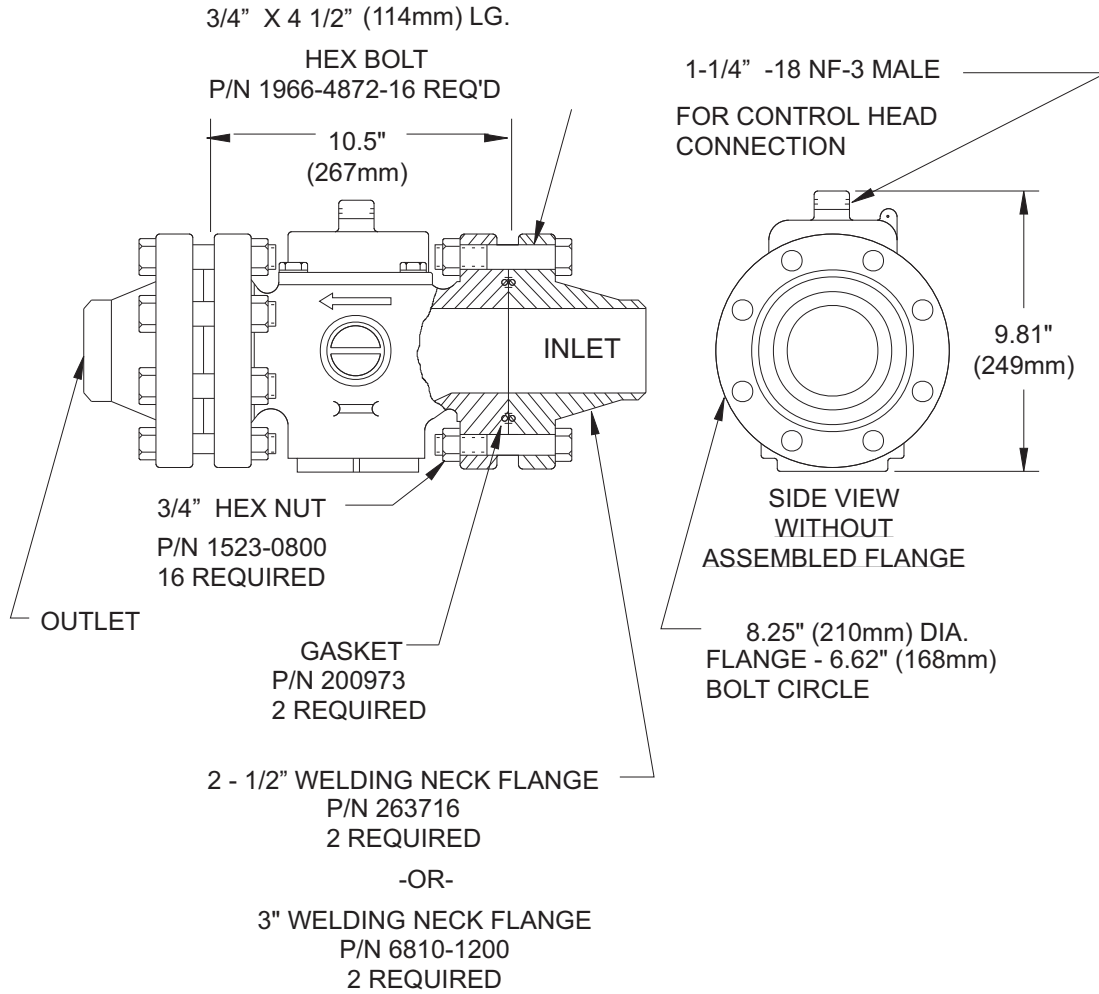

MATERIALS:

Valve Body: Brass
Gasket: Iron
Flanges, Bolts, & Nuts: Steel

Note: VALVE MUST BE INSTALLED WITH ARROW
POINTING IN DIRECTION OF FLOW.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com