

Component Description


Check Valves, 3-Inch (for use on 3" or 2 1/2" Pipe Diameter) Data Sheet

Effective: January 2018
K-85-5120 Rev AB

FEATURES

- UL Listed, ULC Listed, and FM Approved for use with systems listed below in the Table, "COMPATIBILITY", on page 2.
- For use on 3" or 2 1/2" pipe diameter. Order two welding neck flanges to match pipe diameter for each 3" check valve.
- RoHS compliant

P/N: 81-870100-000

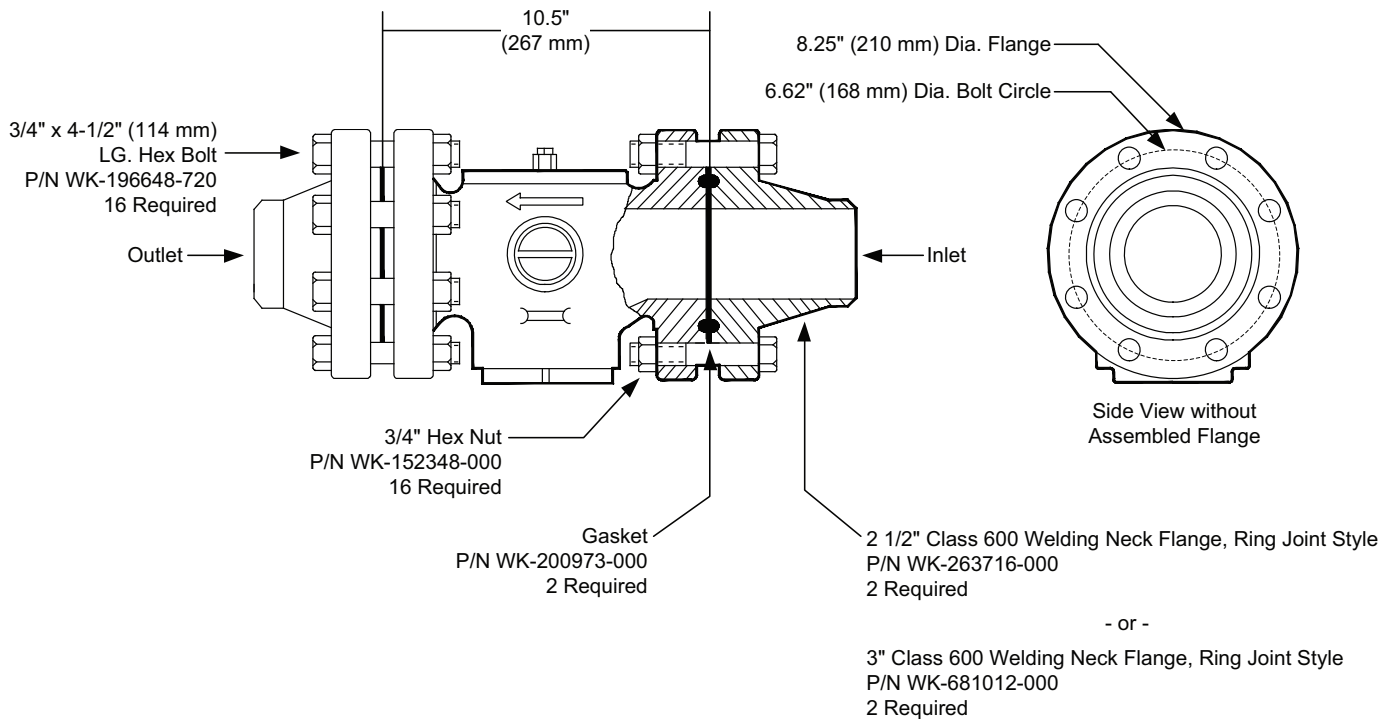

Note: Valve must be installed with the arrow pointing in the direction of flow.

MATERIALS

Valve Body: Brass
Gasket: Iron
Flanges, Bolts and Nuts: Steel

ORDER INFORMATION

Pipe Diameter	Welding Neck Flange P/N	Qty Required
2-1/2 in.	WK-263716-000	2
3 in.	WK-681012-000	2

COMPATIBILITY

Series	DIOM P/N
Kidde ECS 500 psi with FK-5-1-12 Agent	06-237585-001
Kidde ECS with 3M™ Novec™ 1230 Fire Protection Fluid	06-236553-001
Kidde ADS with 3M™ Novec™ 1230 Fire Protection Fluid	06-237256-001
Kidde Marine with 3M™ Novec™ 1230 Fire Protection Fluid	06-236559-001
Kidde ADS with 3M™ Novec™ 1230 Fire Protection Fluid	06-237257-001
Kidde ECS with HFC-227ea Agent	06-236115-001
Kidde ECS Marine with HFC-227ea Agent	06-236225-001
Kidde ADS with HFC-227ea Agent	06-236068-001
Kidde ADS Marine with HFC-227ea Agent	06-236595-001
Kidde High Pressure CO ₂	81-CO2MAN-001
Kidde Fire Systems Marine Carbon Dioxide Version 2.4 DIOM	220610
Kidde 3M™Novec™ 1230 (for UTC India Specifications)	06-237127-600
Kidde ECS with FM-200™ (for UTC India Specifications)	06-237298-001

EXPORT INFORMATION (USA)

Jurisdiction: EAR
Classification: EAR99

This document contains technical data subject to the EAR.

All trademarks are the property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. believes this data to be accurate, but it is published and presented without any guarantee or warranty whatsoever. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The fire suppression system design, installation, maintenance, service and troubleshooting must be performed by trained, authorized Kidde Fire Systems distributors for the product to work correctly. If you need more information on this product, or if you have a particular problem or question, contact: KIDDE-FENWAL, INC., Ashland, MA 01721 USA, Telephone: (508) 881-2000.

