

CO₂ Component Description




A UTC Fire & Security Company

Use of Flanged Nozzle Mounting Kit to Add Frangible Disc to Type "S" Flanged Nozzle Not Mounting to Duct or Enclosure

Effective: February 2007
K-81-1142

P/N: 803330

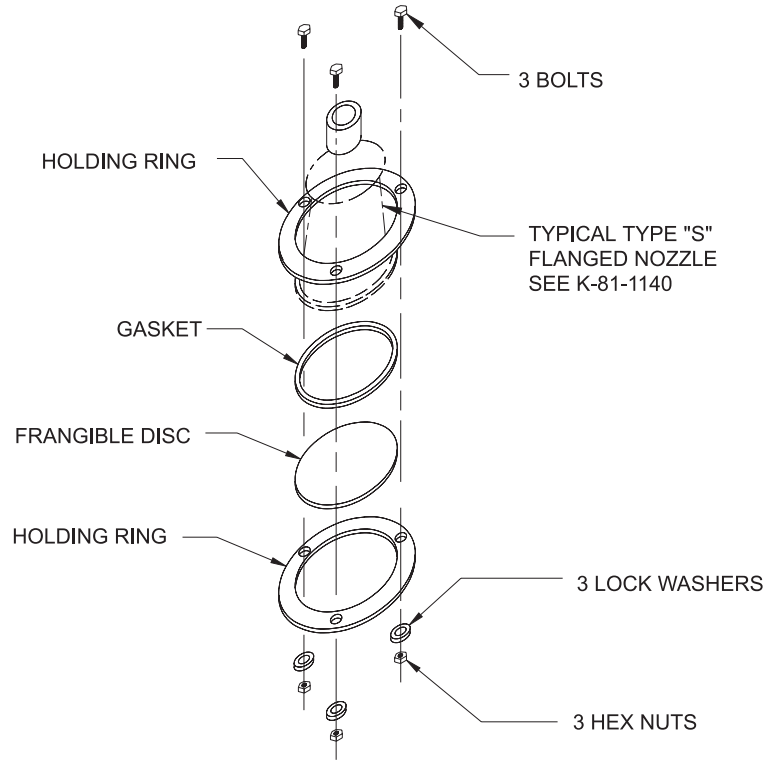

BOLTS: 5/16 -18 X 1/2"

LOCK WASHERS: 5/16

HEX NUTS: 5/16 -18

MATERIALS

RINGS: HOT ROLLED STEEL

GASKET: LEATHER

FRANGIBLE DISC: ALUMINUM P/N 31002 OR
STAINLESS STEEL P/N 81-220299-000

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com