

# FE-13 Component Description


## Pressure Operated Explosion Proof Switch



A UTC Fire & Security Company

Effective: April 2007  
K-96-3170

P/N: 981332

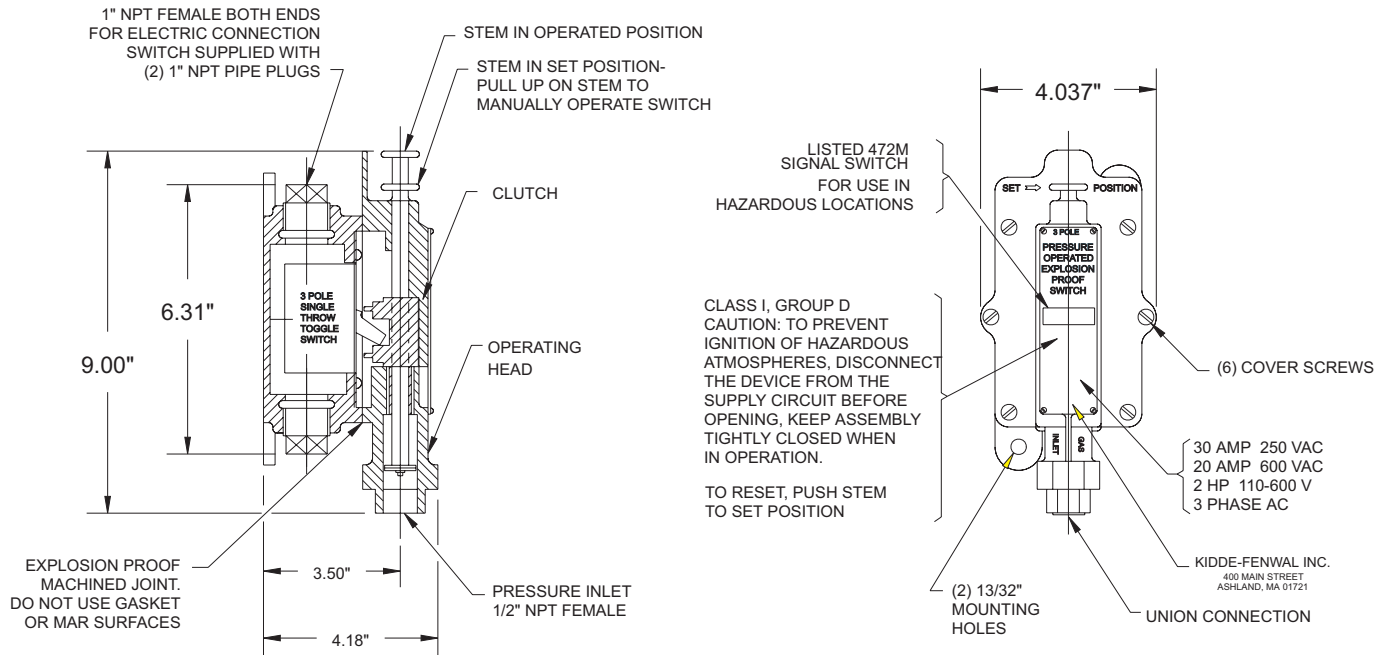

### MATERIALS:

**BASE: MALLEABLE IRON**

**OPERATING HEAD: CAST BRONZE**

### Notes:

1. Toggle switch may be mounted in base for either normally open to normally closed or normally closed to normally open contact transfer upon operation. Illustration shows position of toggle when switch is in set position.
2. Any load connected to the switch must not exceed switch rating and shall utilize a suitable protection device (i.e., circuit breaker, fuse).
3. Remove operating head to make electrical connections to toggle switch. When replacing operating head, ensure that toggle engages clutch. Tighten cover screws securely.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.kiddefiresystems.com](http://www.kiddefiresystems.com)